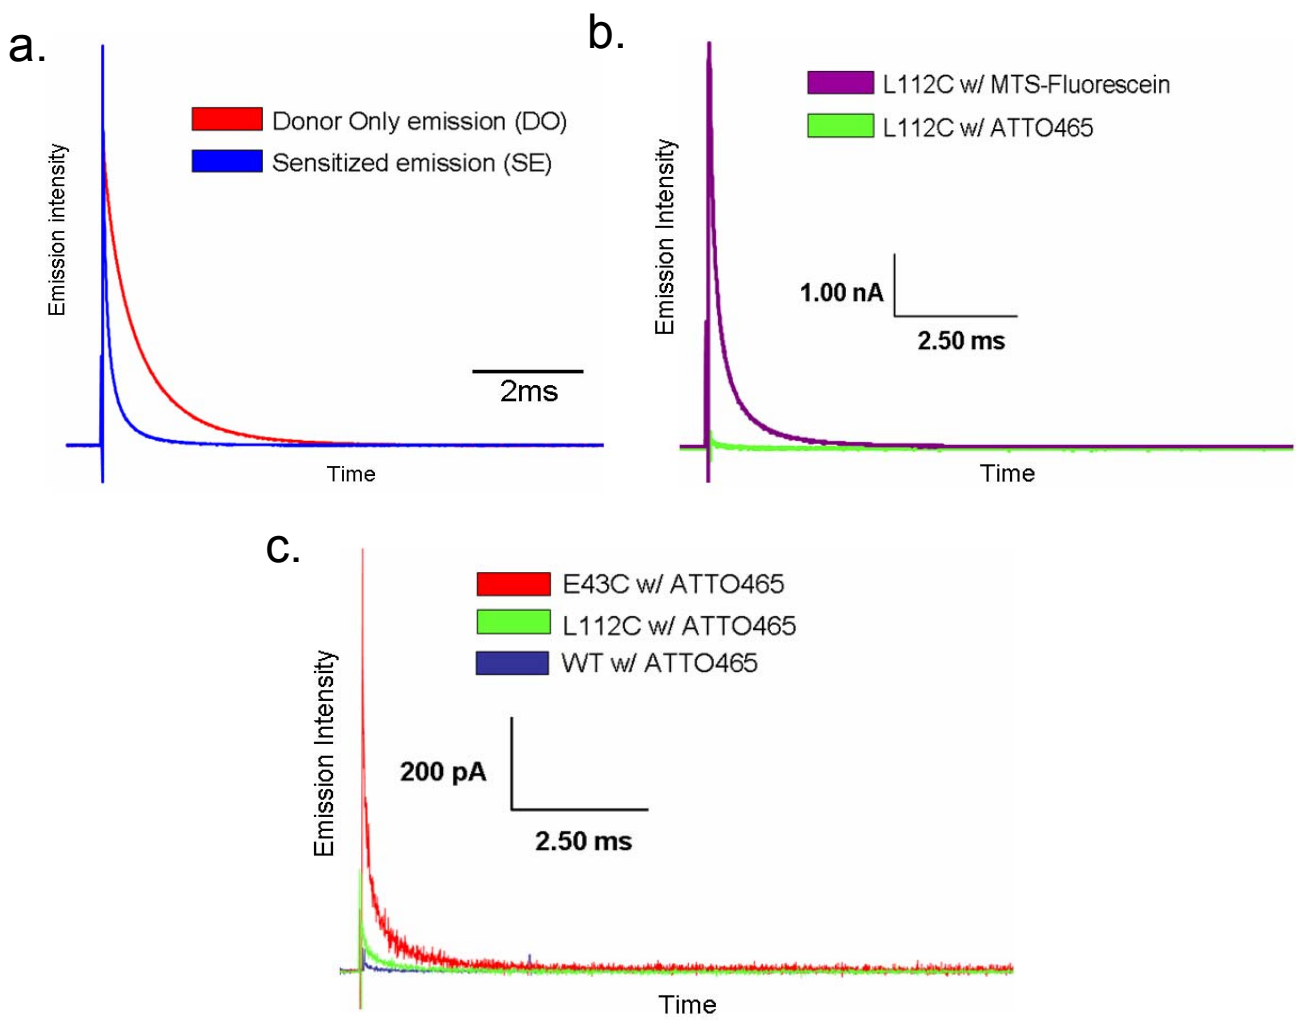
a.
Donor Only emission (DO)
Sensitized emission (SE)
Emission intensity
2ms
Time
b.
L112C w/ MTS-Fluorescein
L112C w/ ATTO465
Emission Intensity
1.00 nA
2.50 ms
Time
c.
E43C w/ ATTO465
L112C w/ ATTO465
WT w/ ATTO465
Emission Intensity
200 pA
2.50 ms
Time